


# FLASHING SHINGLE-TO-SHINGLE TRANSITIONS, GAMBREL ROOF - ISO VIEW

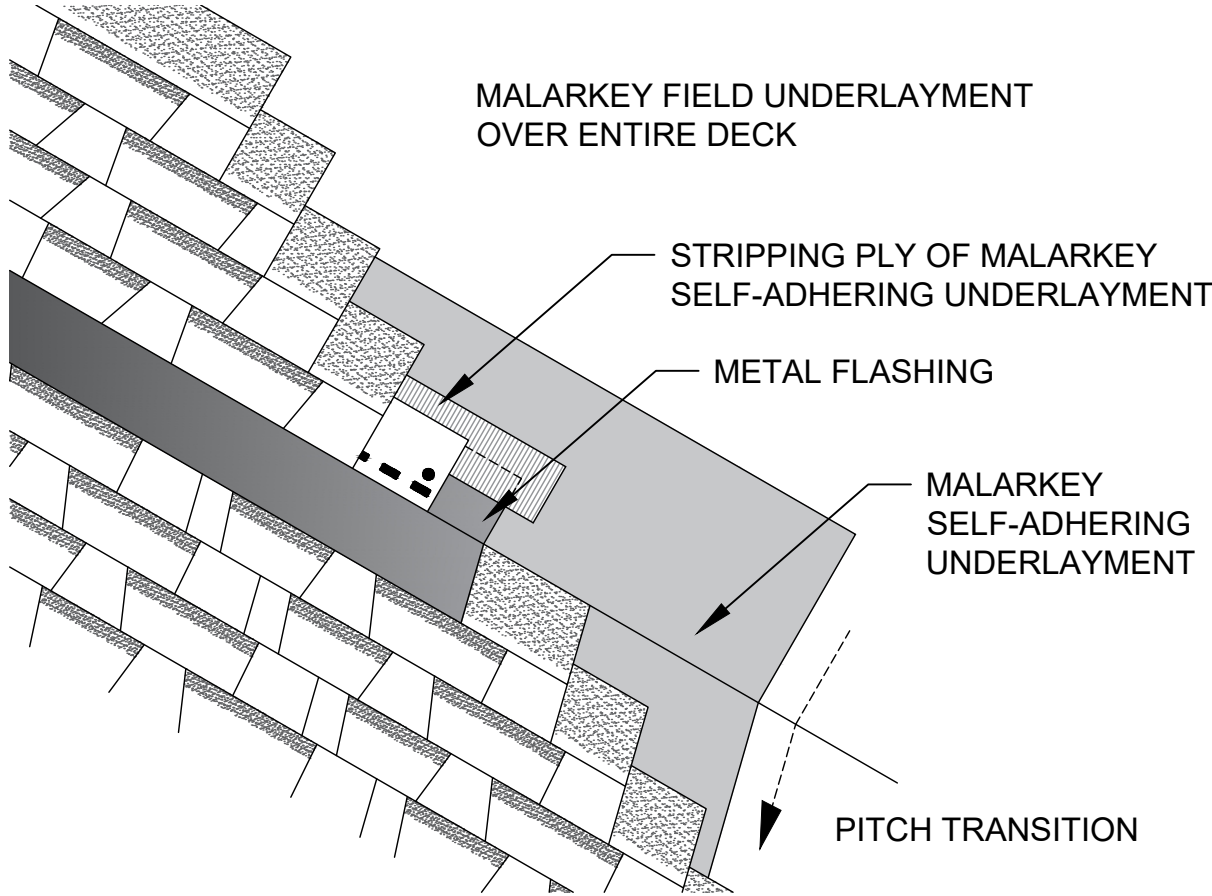

**NOTES:**

- OVER TRANSITION CHANGE, INSTALL MINIMUM HALF-WIDTH, MALARKEY SELF-ADHERING UNDERLAYMENT; CENTER OVER TRANSITION BREAK.
- SHINGLE UP TO THE TRANSITION BREAK.
- INSTALL 26 GA. CORROSION-RESISTANT METAL FLASHING (HEMMED EDGE ON DOWN-SLOPE SIDE IS OPTIONAL):
  - LAP LOWER FLANGE OVER SHINGLES ON THE DOWN-SLOPE SIDE; SECURE WITH GASKETED FASTENERS; SEAL JOINTS WITH A BEAD OF SEALANT.
  - NAIL UPPER FLANGE TO THE DECK ON THE UP-SLOPE SIDE.
  - STRIP-OFF UPPER FLANGE WITH MINIMUM 6"-WIDE (152 MM) MALARKEY SELF-ADHERING UNDERLAYMENT TO COVER FASTENERS: 3" (76 MM) ON THE FLANGE, 3" (76 MM) ON THE FIELD.
- RESUME SHINGLING UP THE ROOF OVER THE UPPER FLANGE OF THE FLASHING; AS YOU WOULD AT THE EAVE, BEGINNING WITH A STARTER SHINGLE.

## STEEP SLOPE 31B - ISO



Rev. 5/21

|               |                     |
|---------------|---------------------|
| PROJECT NAME: | DATE:               |
|               | SCALE: NOT TO SCALE |
| ADDRESS:      | PROJECT NO:         |
|               | DRAWING NO. :       |
| OWNER:        | SUBMITTAL NO. :     |